


PT PINOS FIRST FLOOR AND BASEMENT  
RELATIVE HUMIDITY AND MOISTURE CONTENT  
COMPARISON

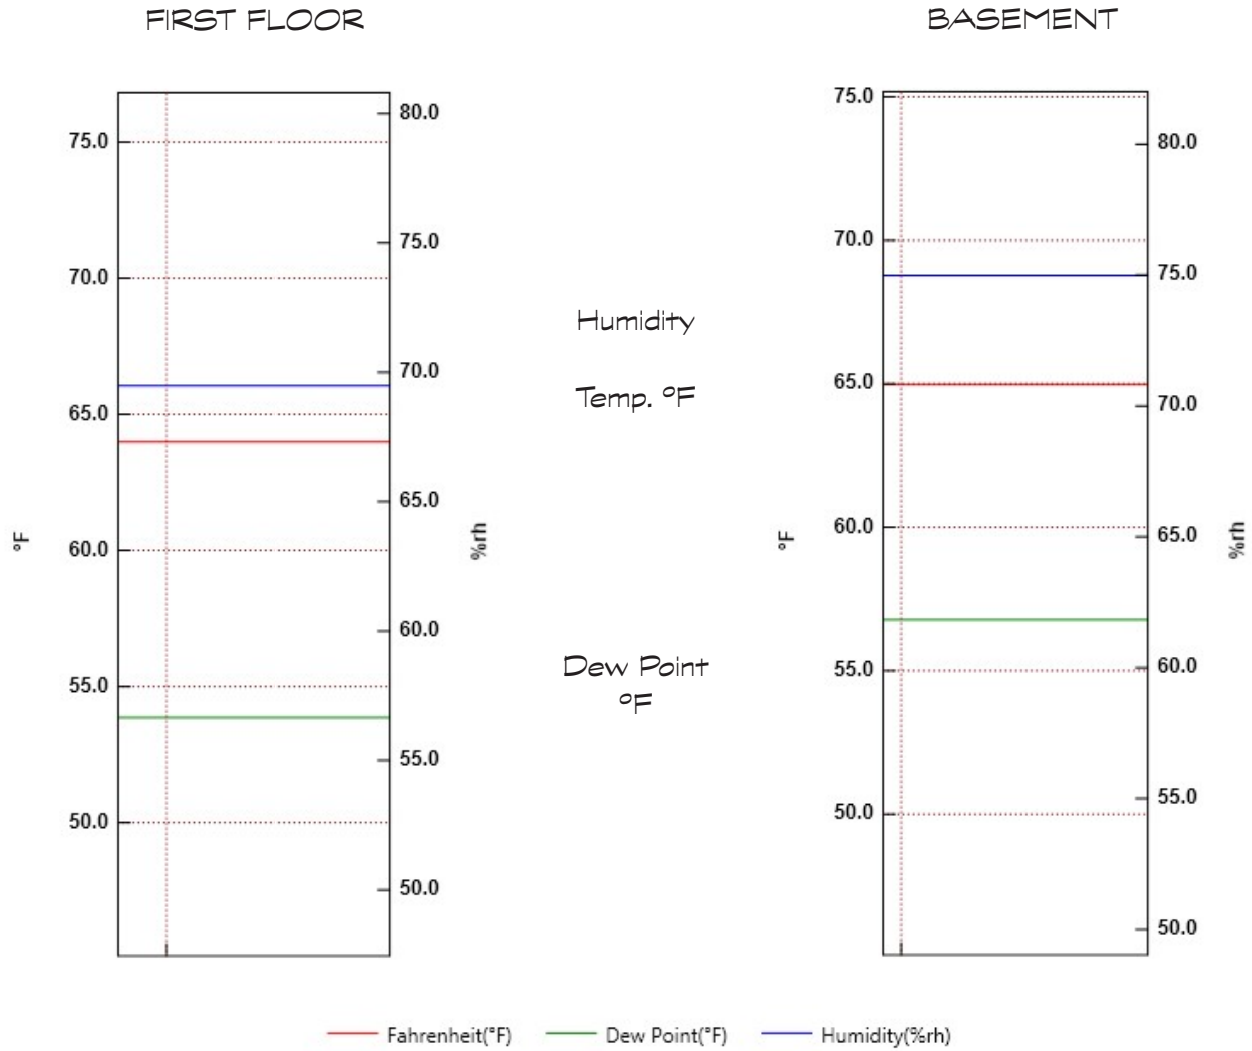

9:00 AM SEPTEMBER 5, 2016

FIRST FLOOR:      TEMP: 64 °F = 17.7777 °C      RH: 69 %      8.78 g H2O/kg AIR

BASEMENT:      TEMP: 65 °F = 18.3333 °C      RH: 75 %      9.88 g H2O/kg AIR

Note: 1 kg air is approximately 0.77 m<sup>3</sup> or 27.31 ft<sup>3</sup>